


Catlabs Pro 320 35mm film test results by Nick Mazur , 2022-10-03


Title:	Catlabs Pro 320 35mm / D76 1+1 / 20C
Test date:	2022-09-29
Analysis date:	2022-10-03
Curves:	4 min, 5.25 min, 8 min, 12 min
Film ISO:	200
Development:	D76 1+1 at 20C
Agitation:	Continuous, in a rotary tube
Method:	0.1 FB+F
Paper ES:	1
Notes:	Data obtained with a calibrated and certified sensitometer, exposed at 3.68 Log Millilux Seconds. Kodak Indicator Stop bath; Ilford Rapid Fixer; Kodak Hypo Clearing Agent; Ilford wash method; Kodak Photo-Flo 200

Dev time	EFS	G	SBR	CI	.3G	Gamma
4 min	20-	0.55	6.04	0.62	1.35	0.43
5.25 min	25-	0.61	5.48	0.68	1.17	0.52
8 min	30+	0.67	4.94	0.76	1.10	0.56
12 min	30++	0.87	3.82	0.89	1.17	0.80

Catlabs Pro 320 35mm / D76 1+1 / 20C

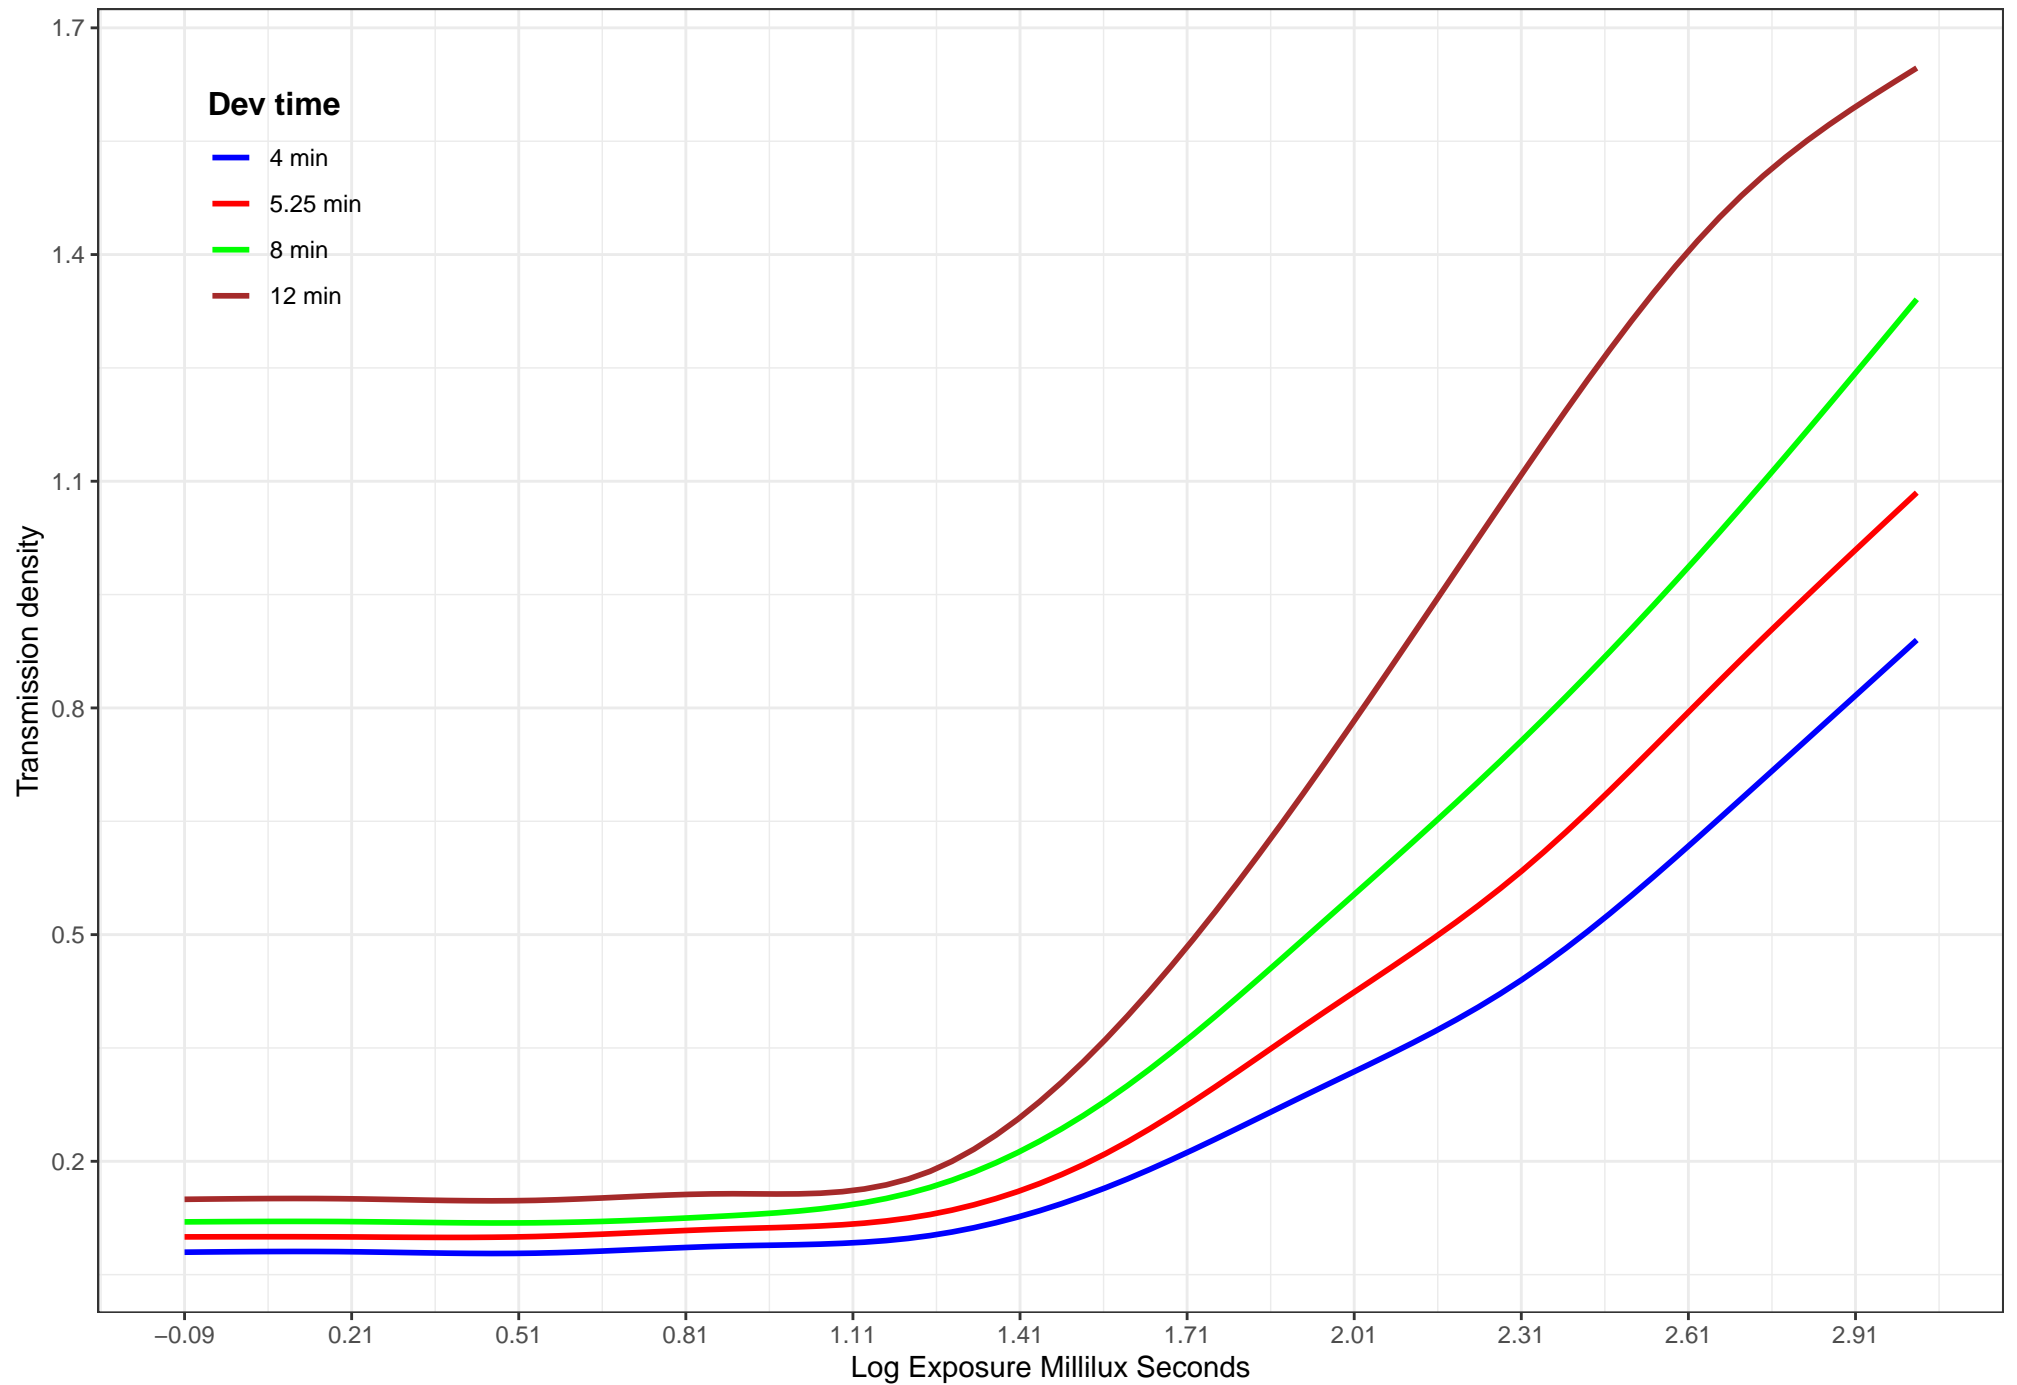


Catlabs Pro 320 35mm / D76 1+1 / 20C

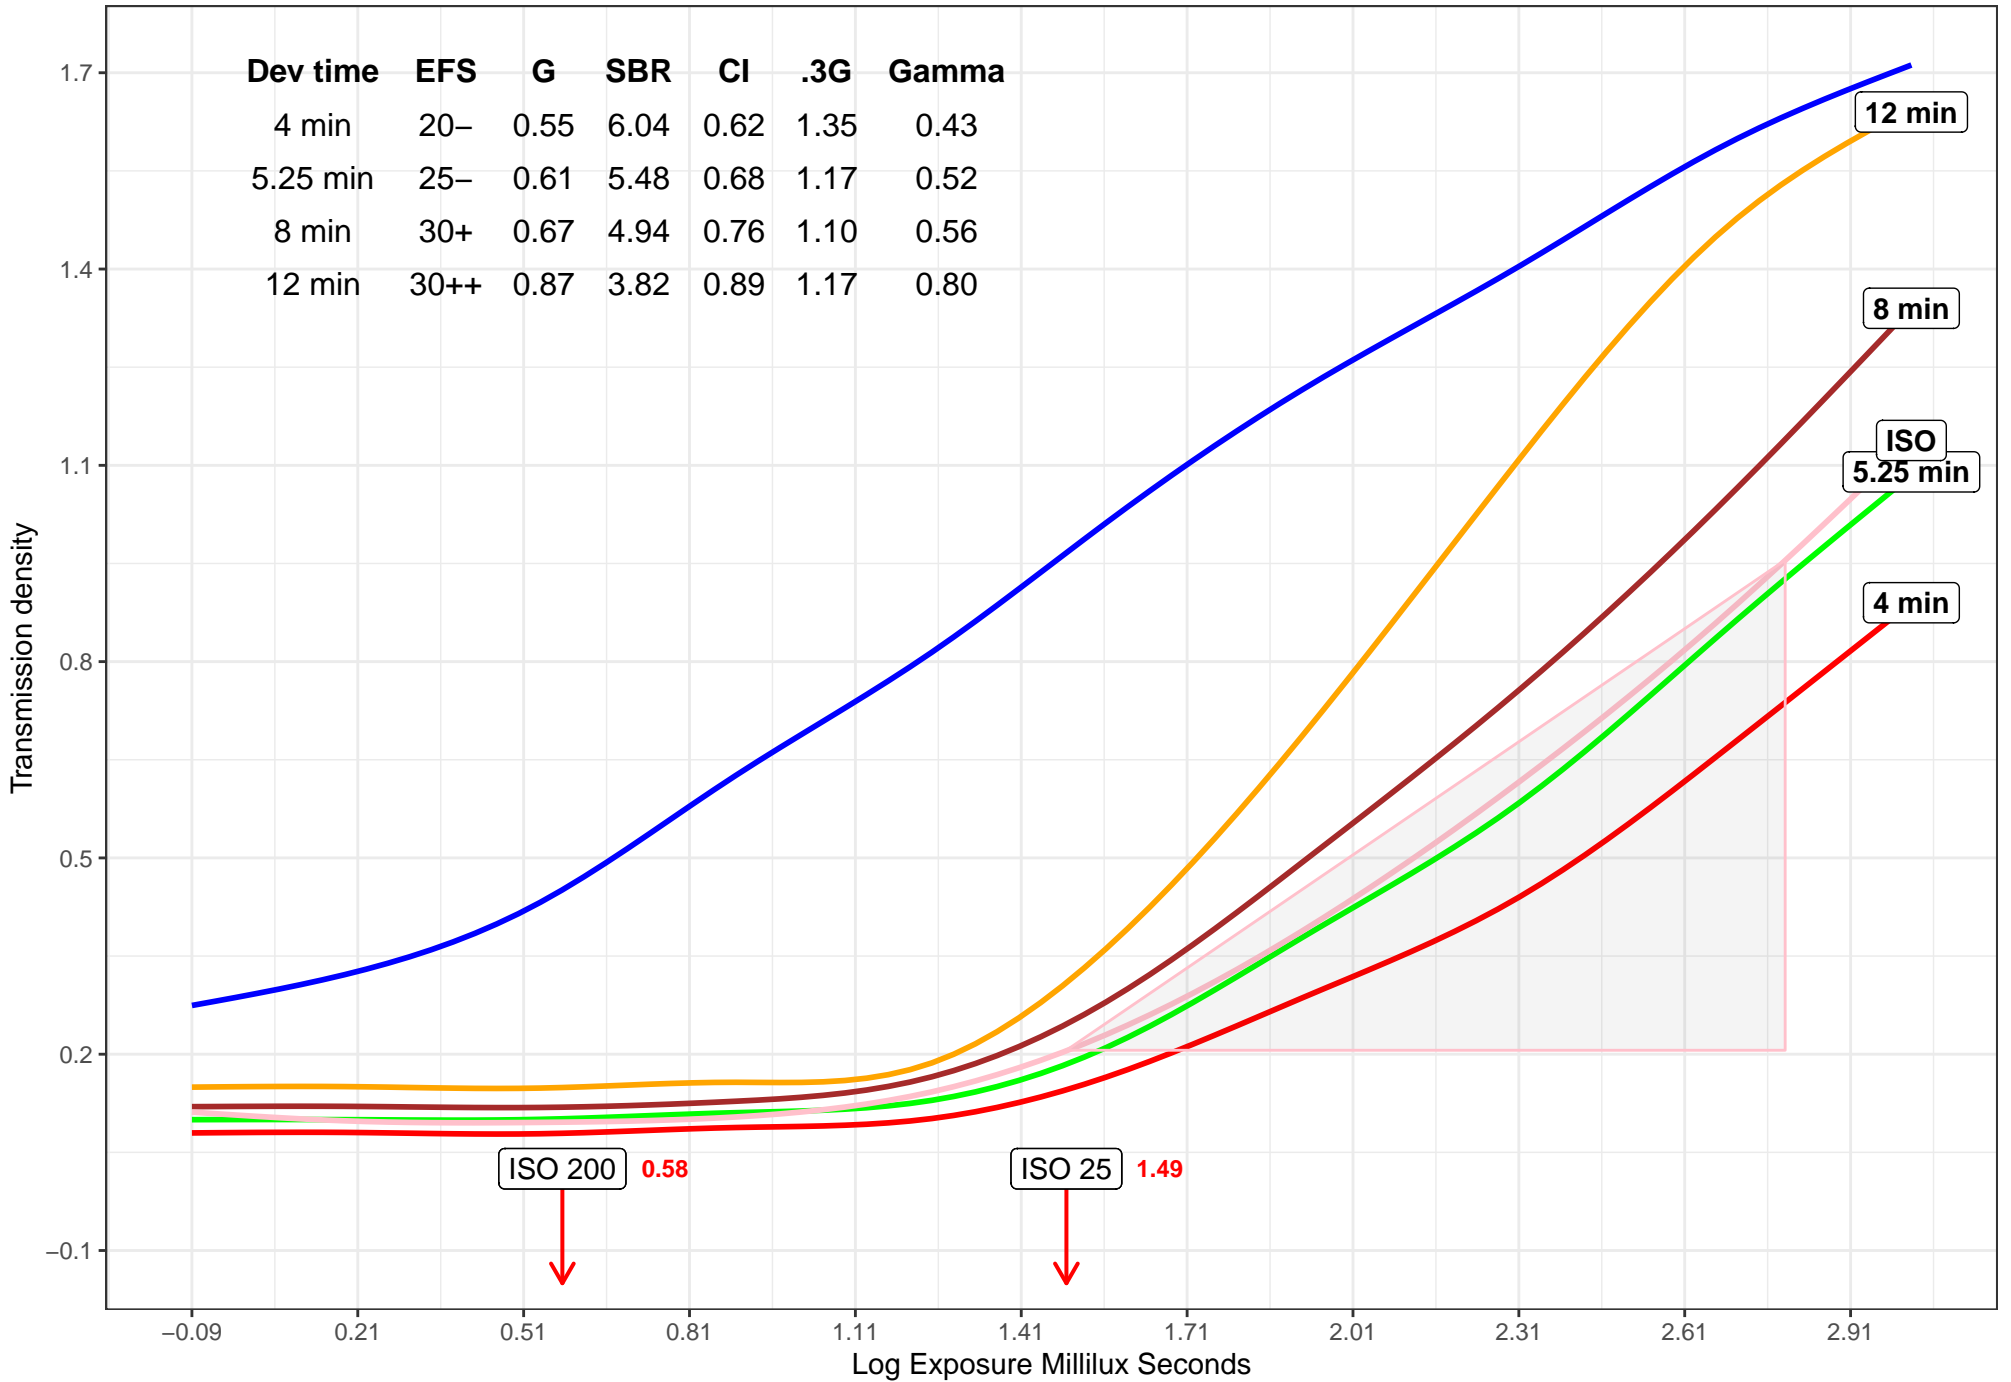


Family of H&D curves

Catlabs Pro 320 35mm / D76 1+1 / 20C

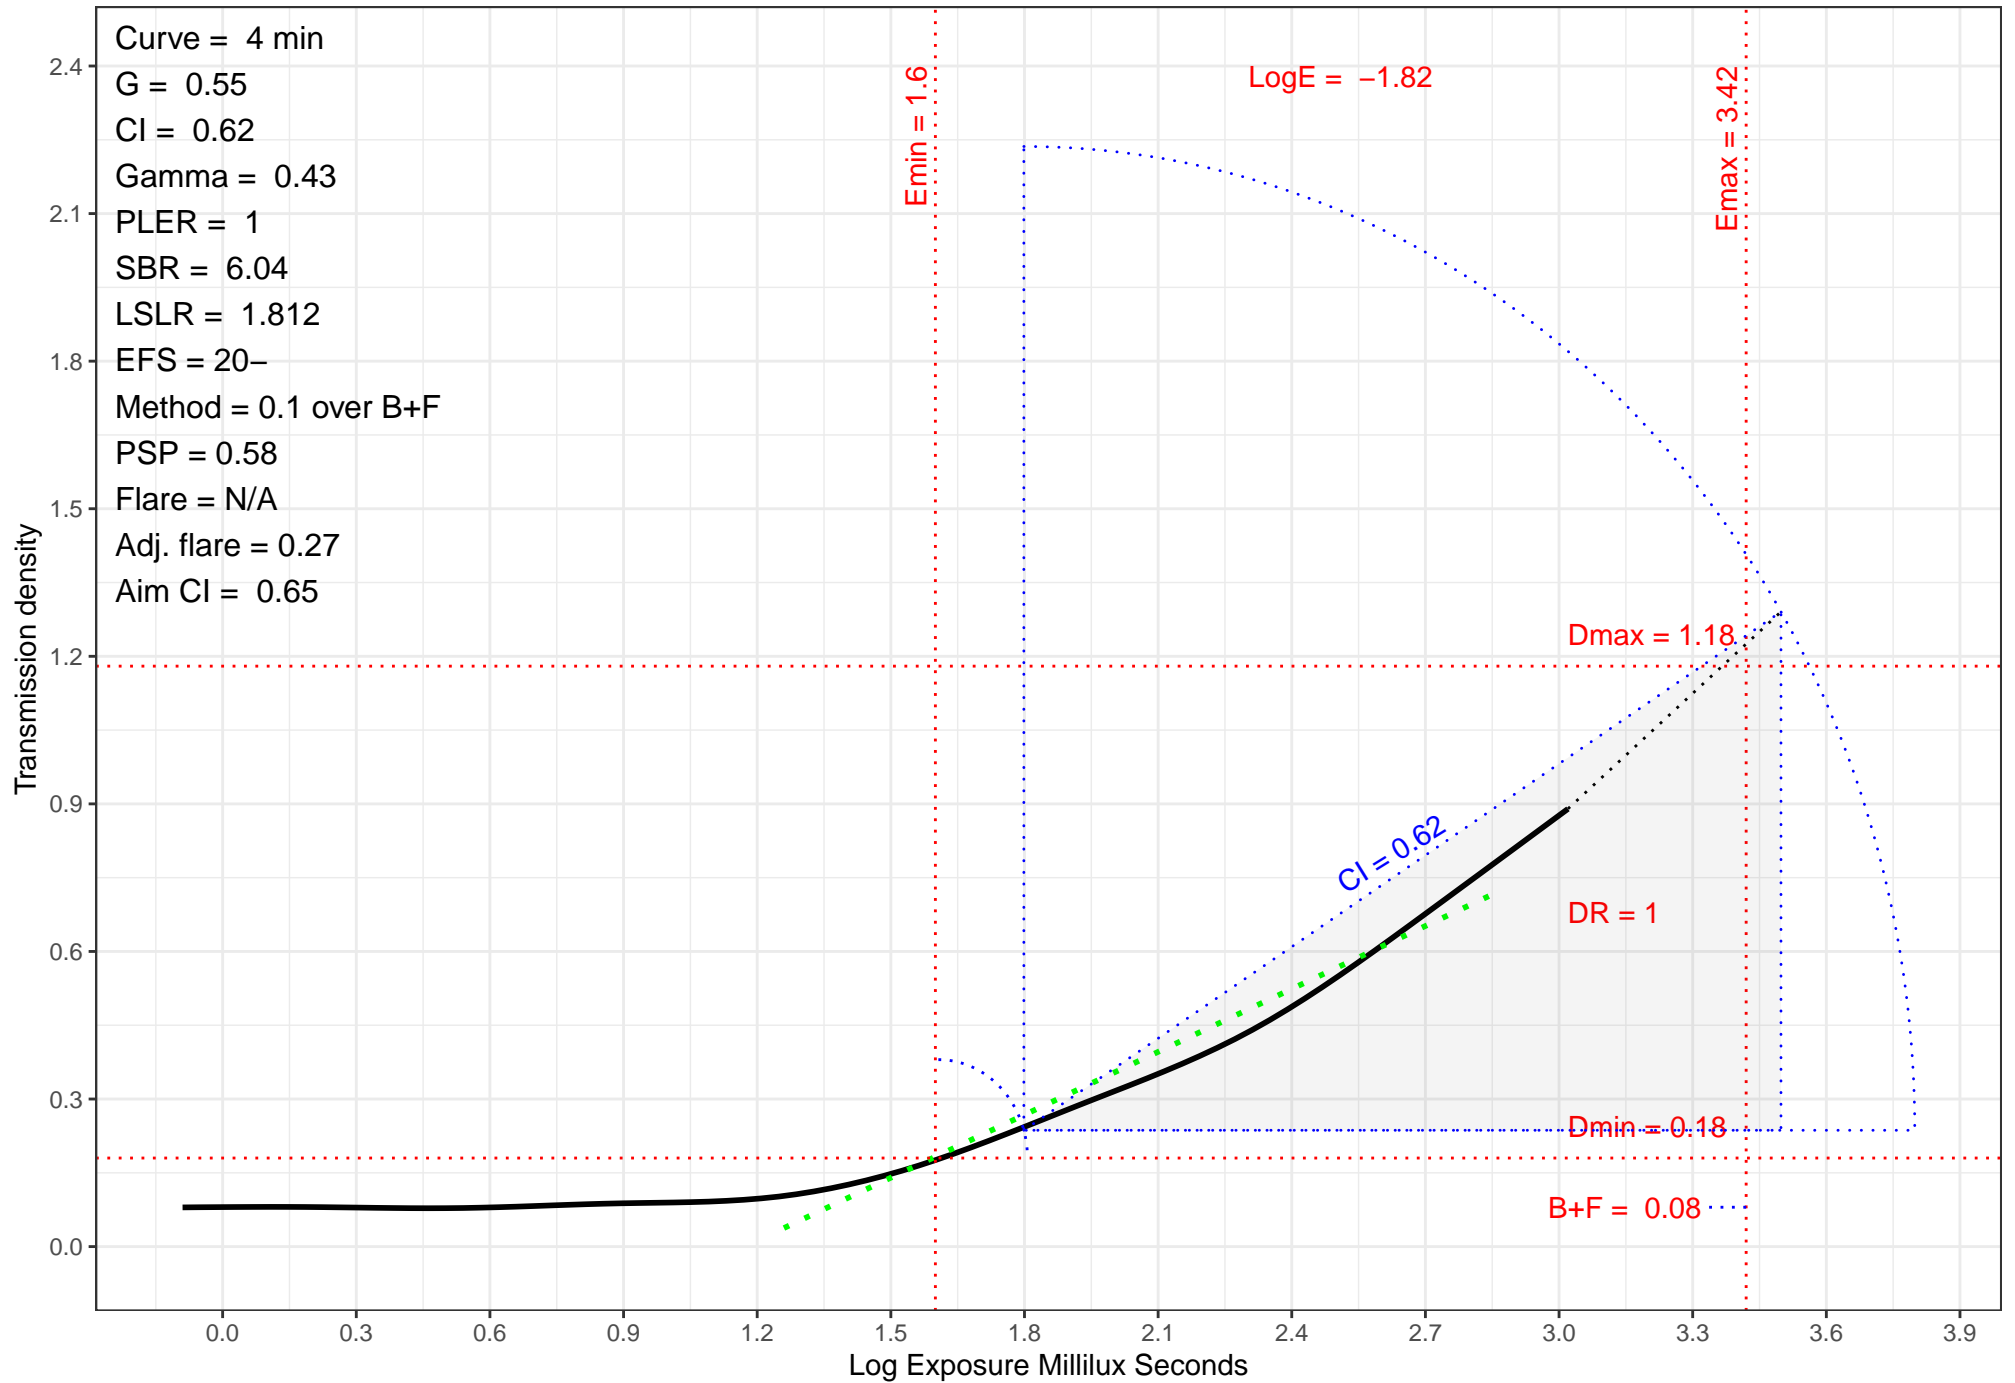


H&D curve for 4 min

Catlabs Pro 320 35mm / D76 1+1 / 20C

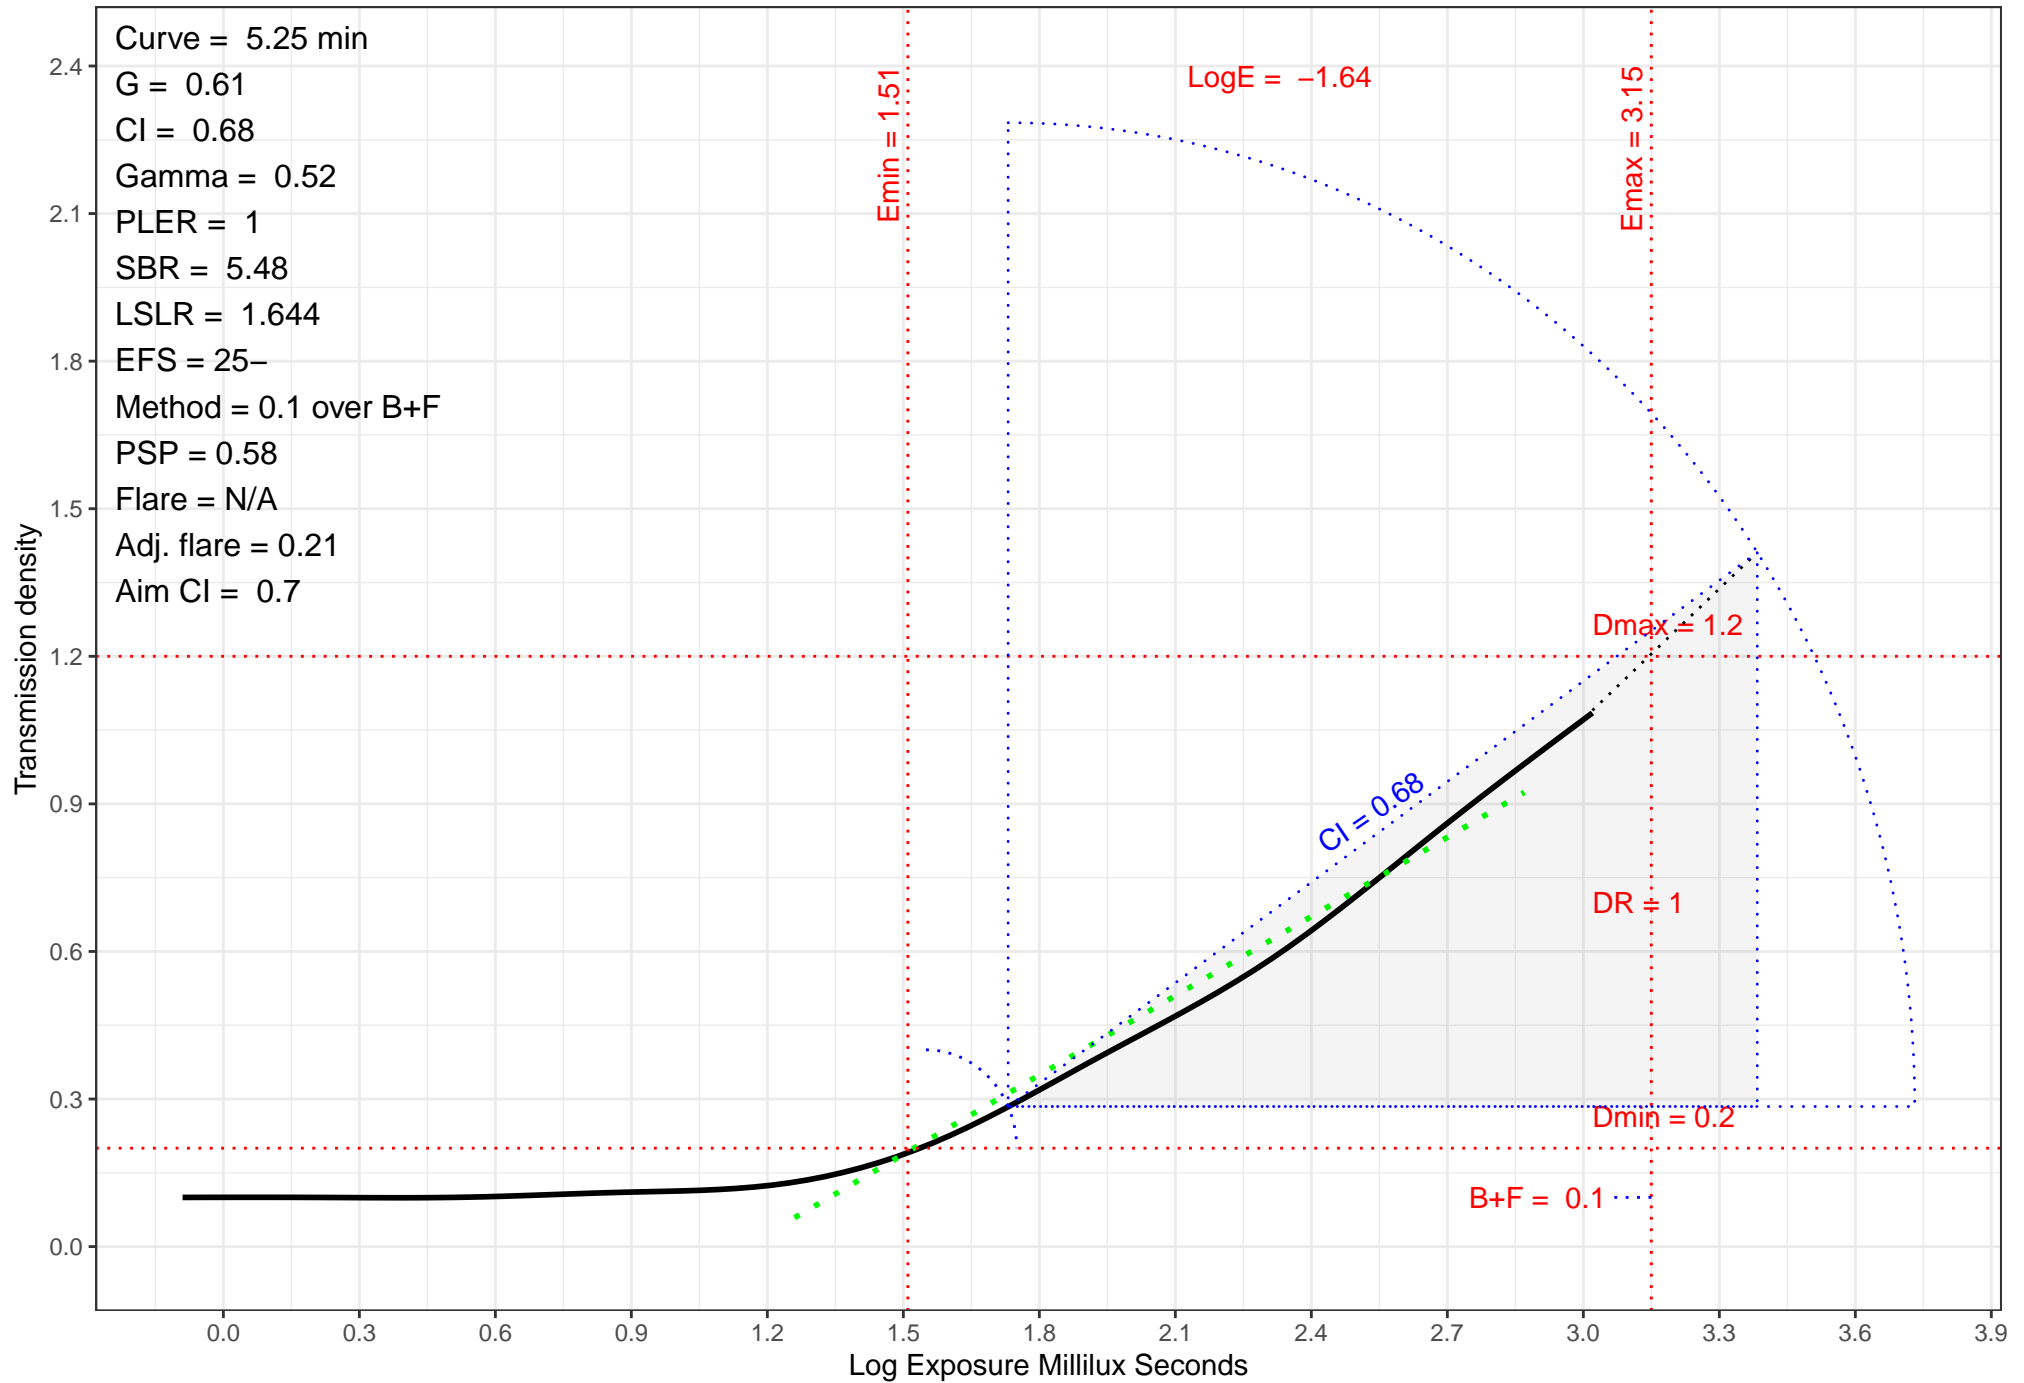


H&D curve for 5.25 min

Catlabs Pro 320 35mm / D76 1+1 / 20C

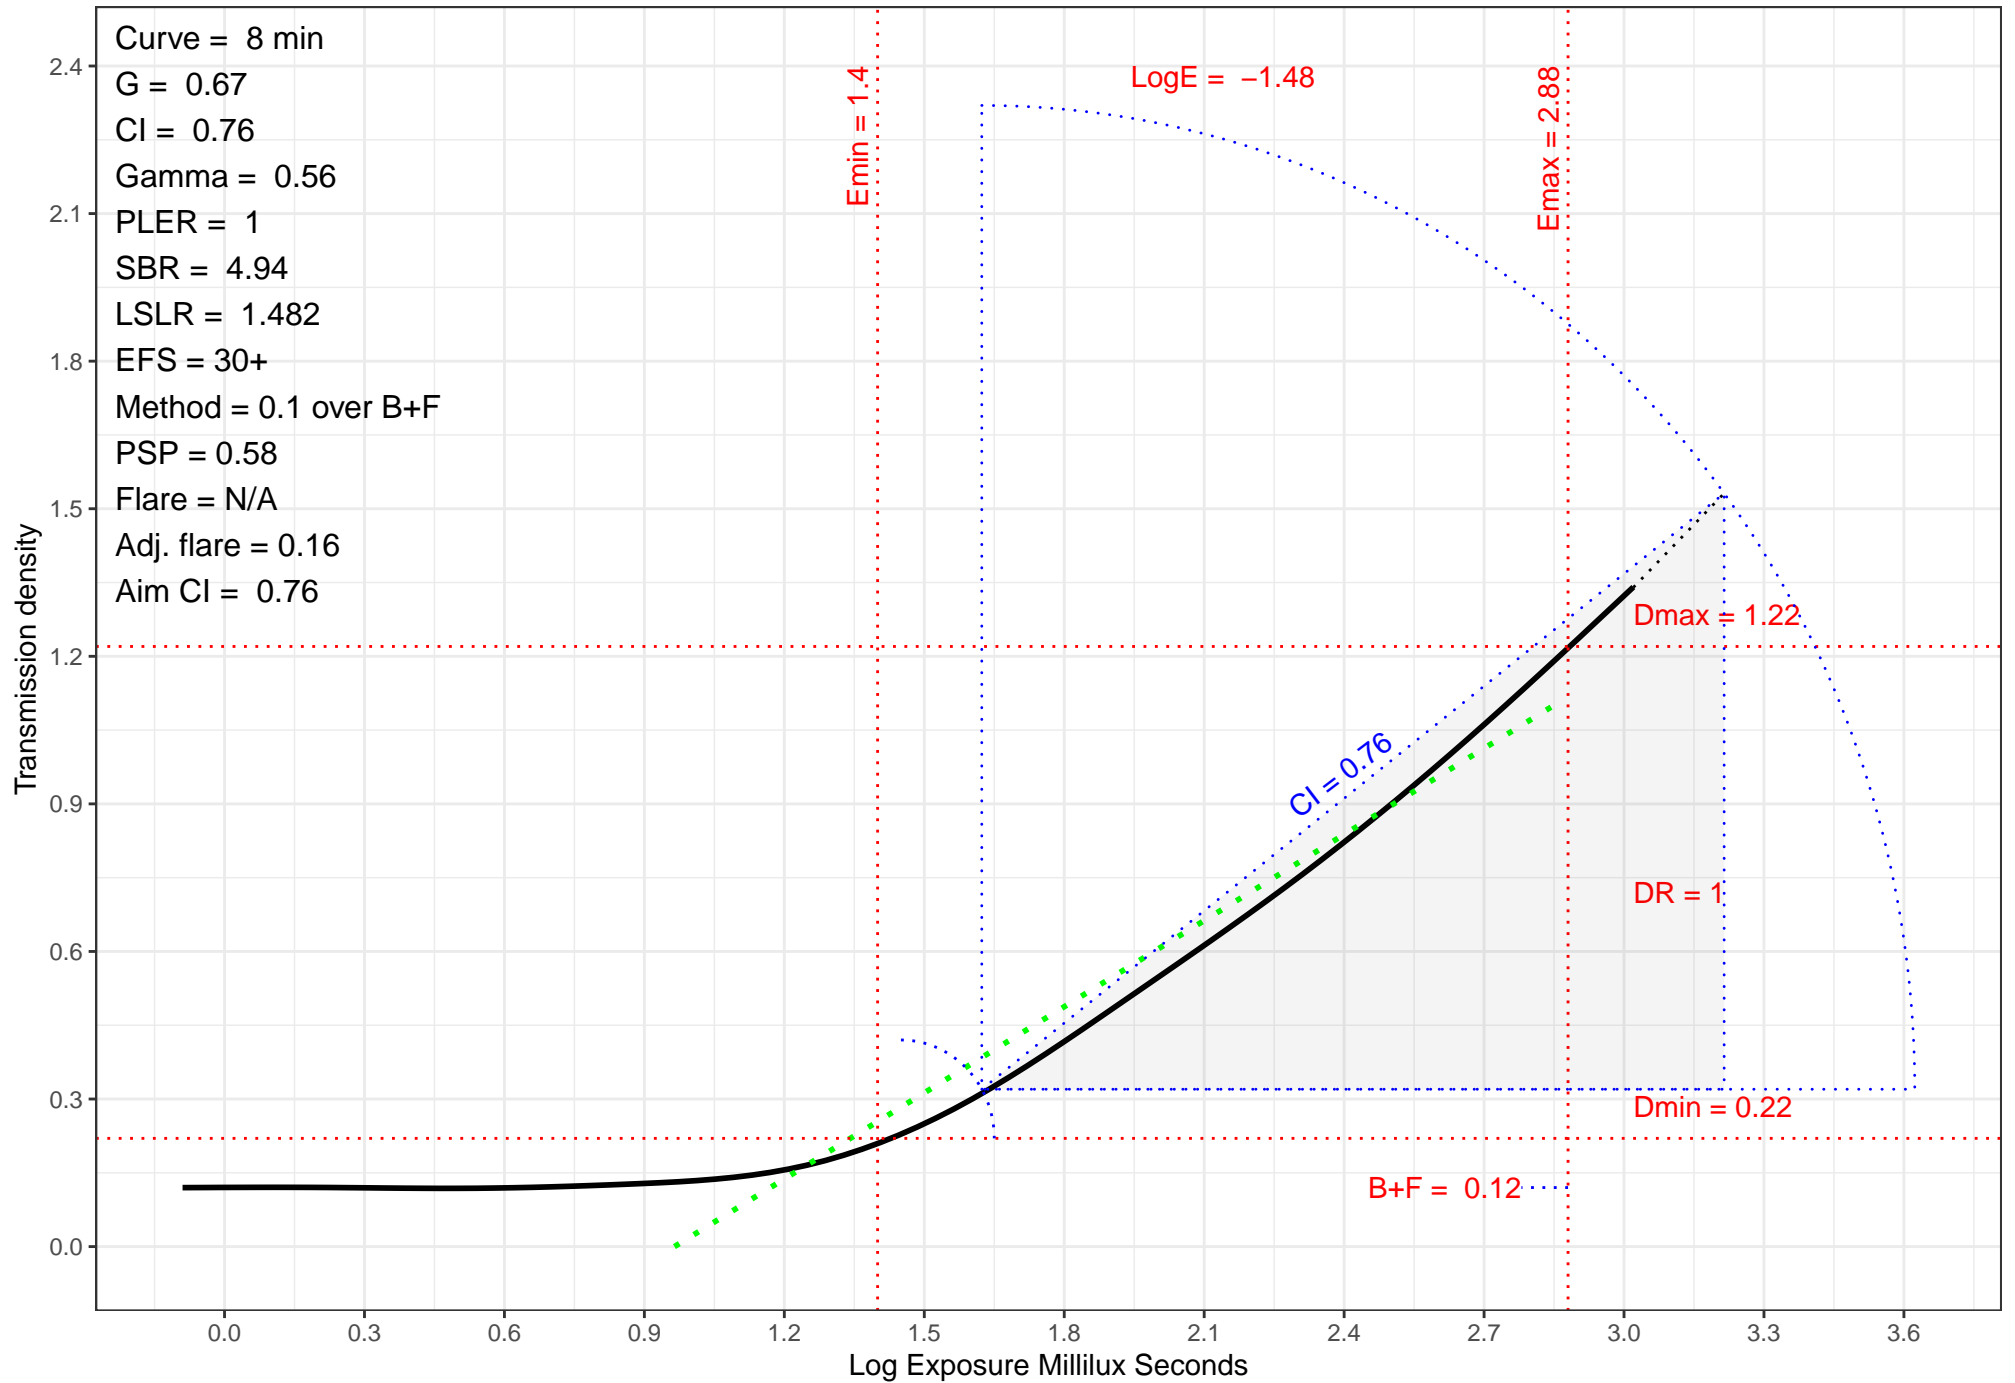


Catlabs Pro 320 35mm / D76 1+1 / 20C

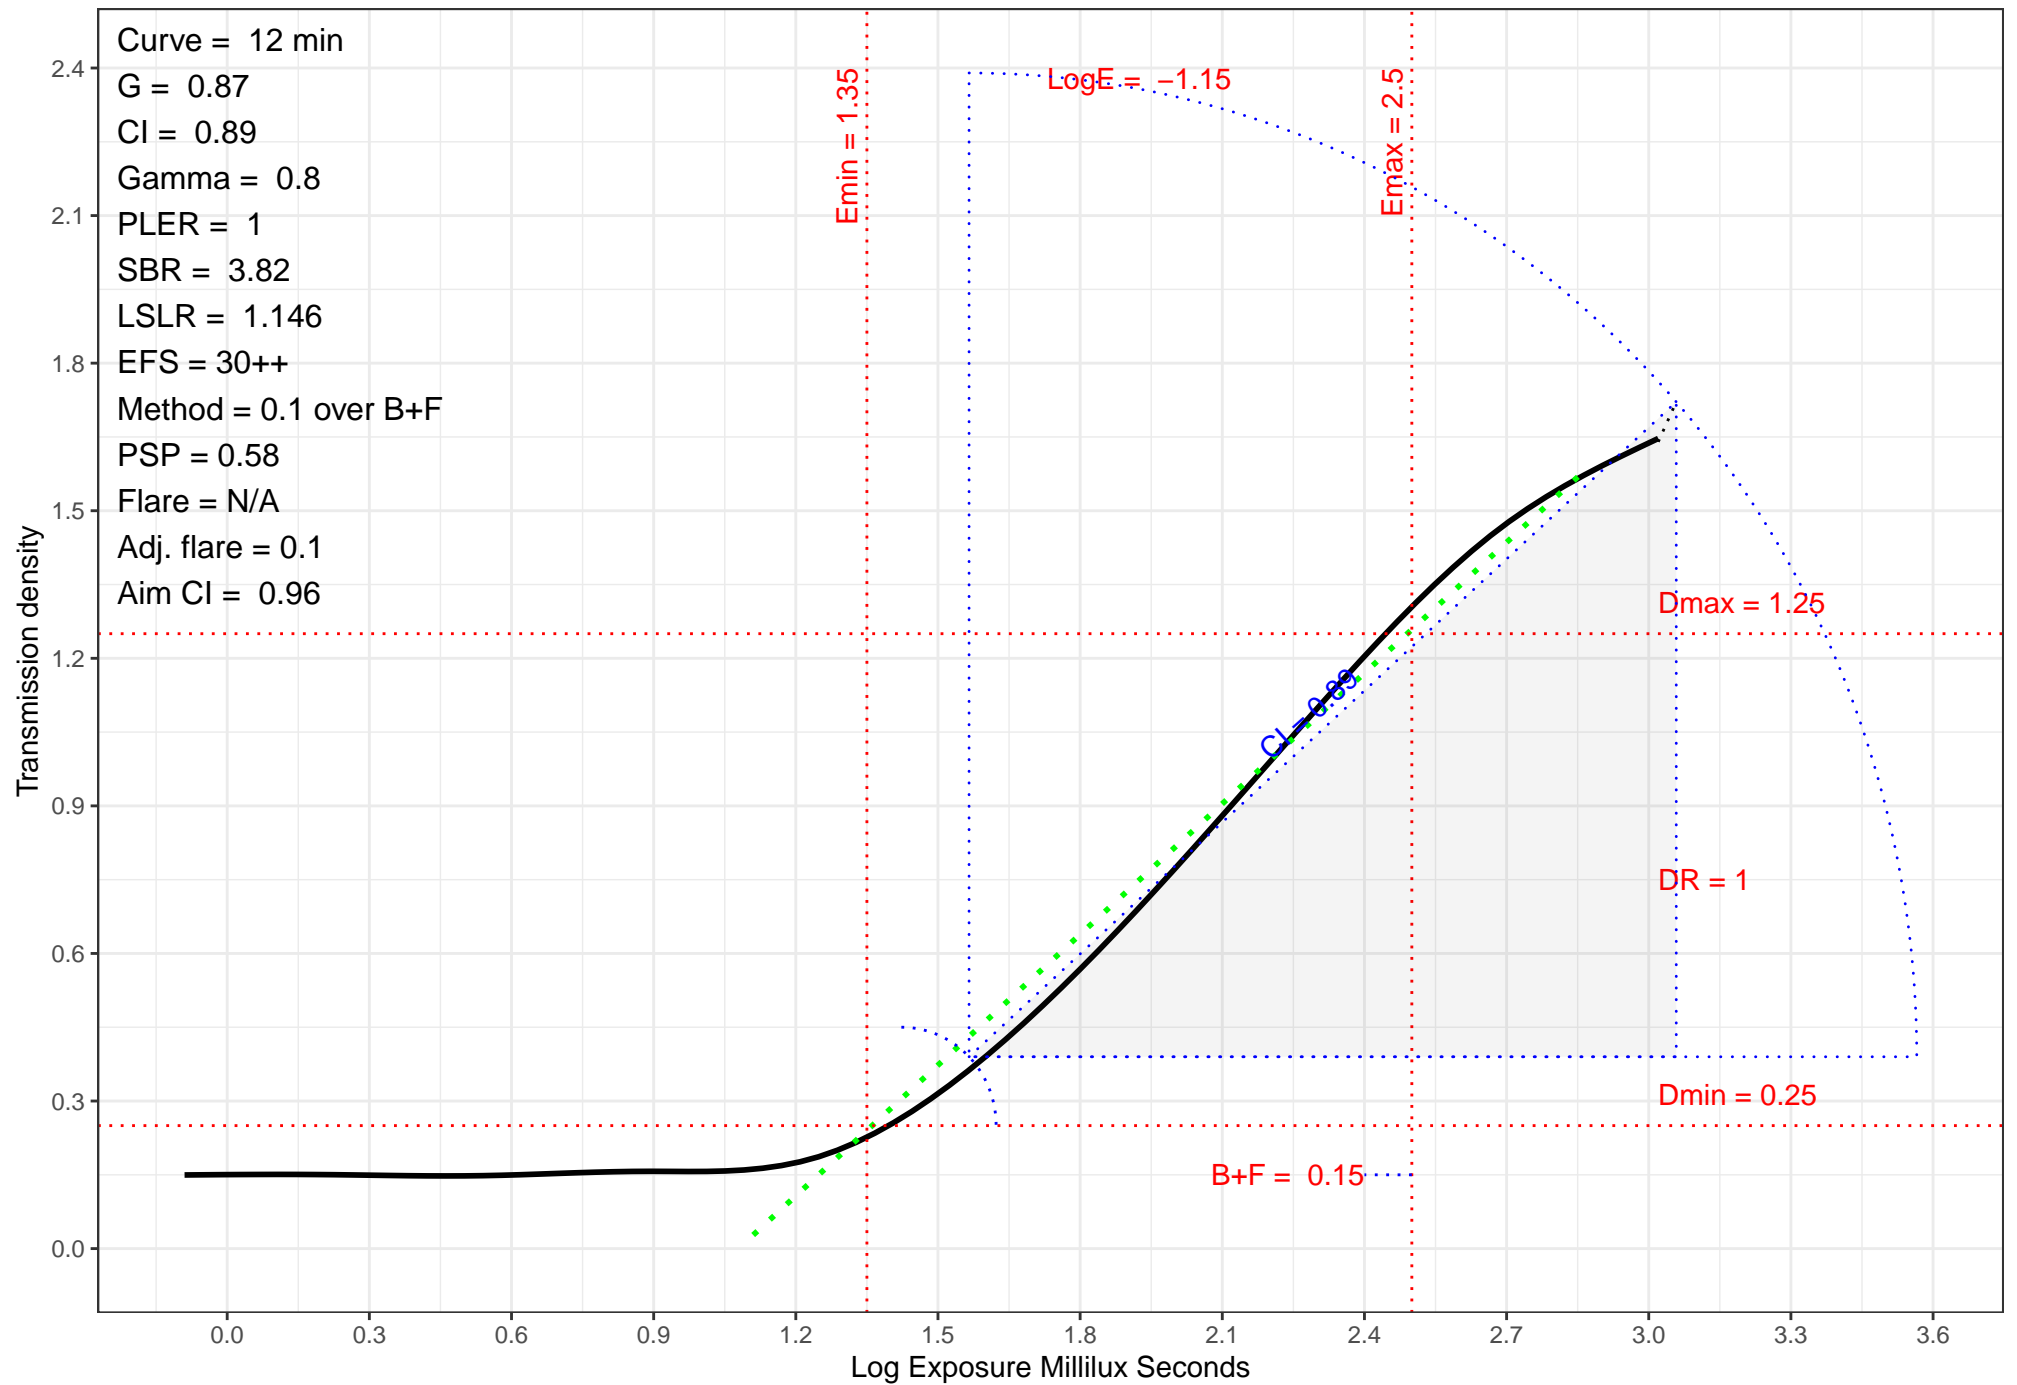


H&D curve for 12 min


Catlabs Pro 320 35mm / D76 1+1 / 20C

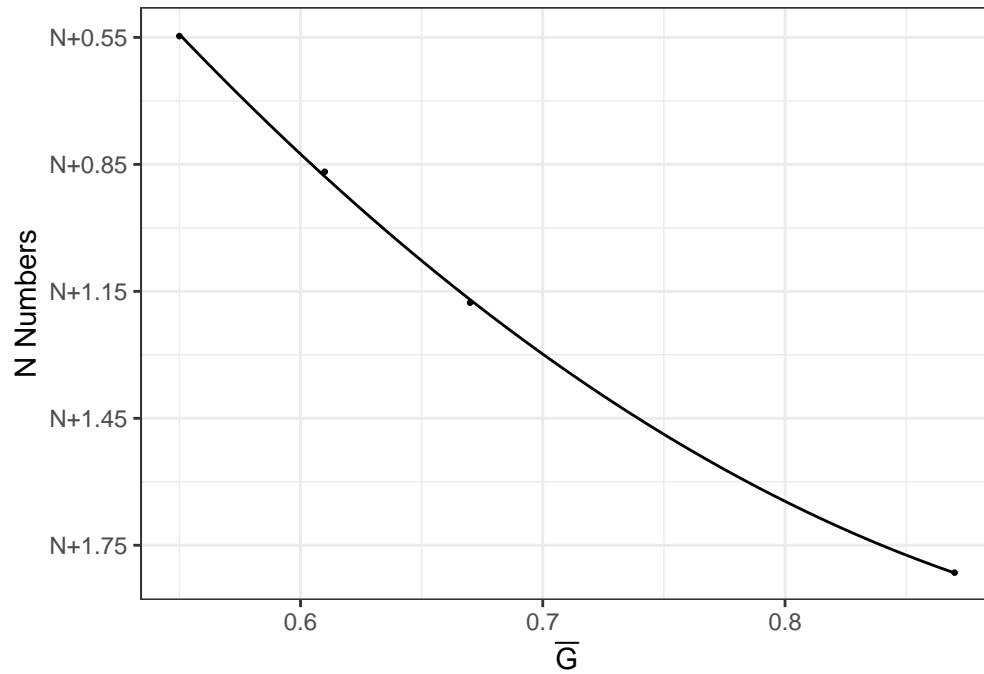


Catlabs Pro 320 35mm / D76 1+1 / 20C

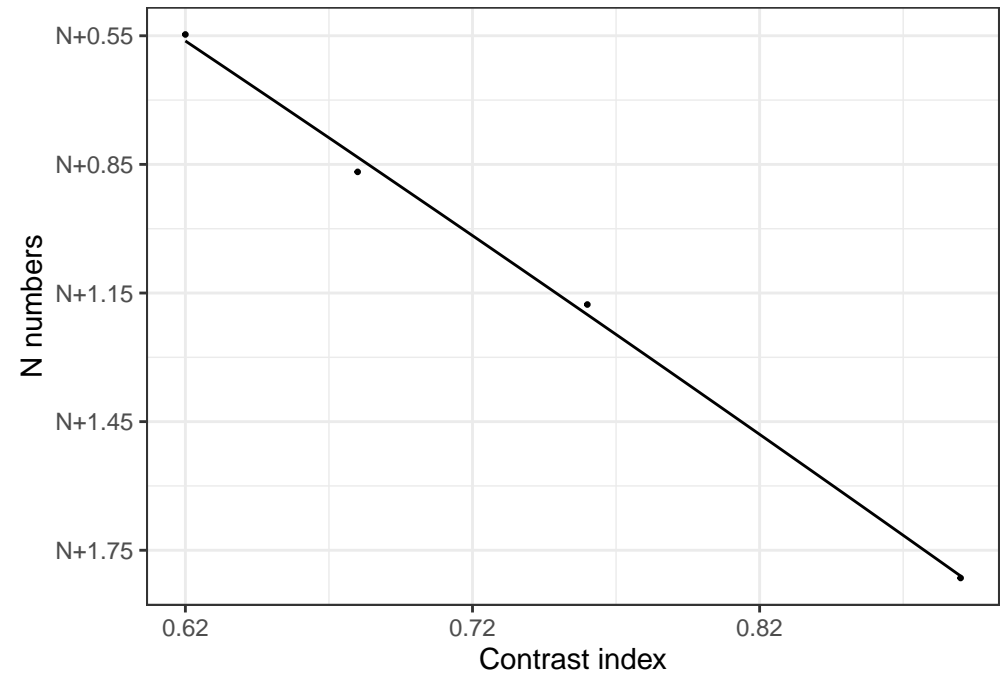


Catlabs Pro 320 35mm / D76 1+1 / 20C

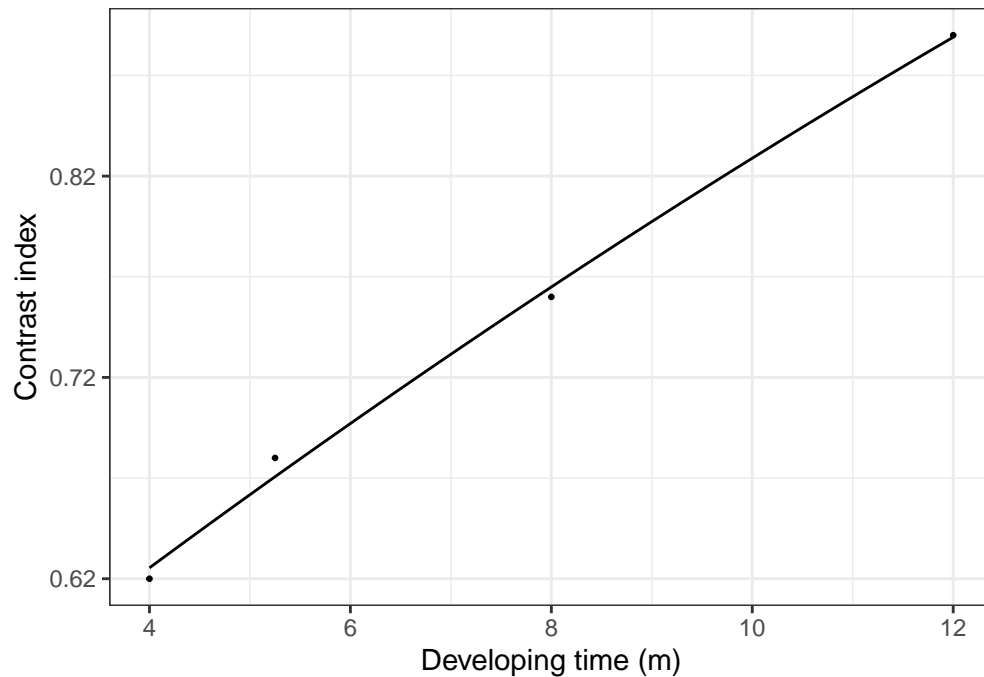


Catlabs Pro 320 35mm / D76 1+1 / 20C

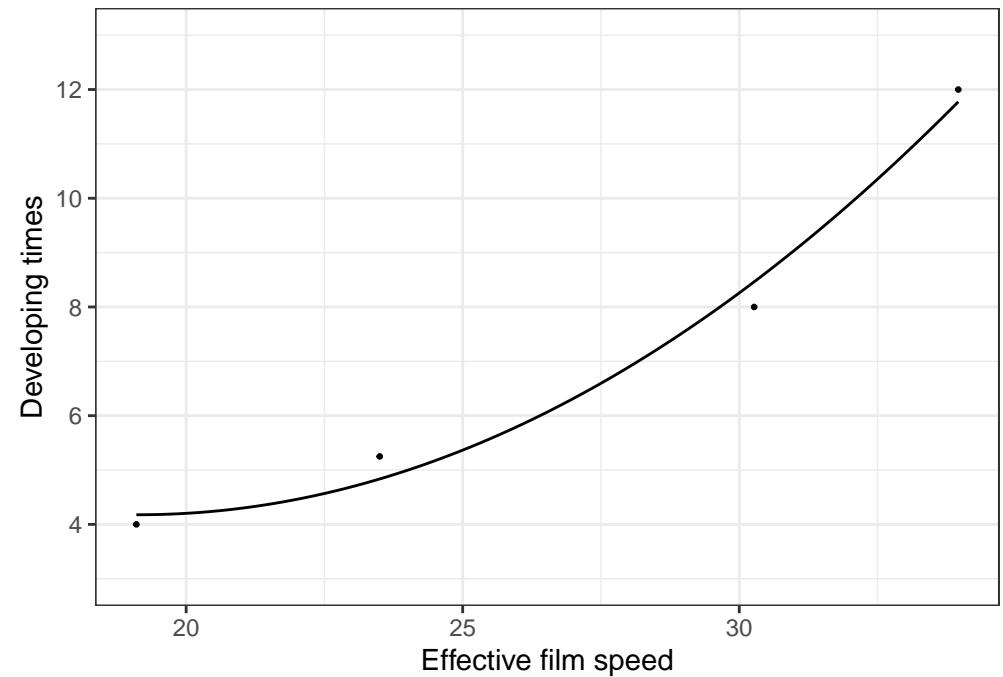


Catlabs Pro 320 35mm / D76 1+1 / 20C

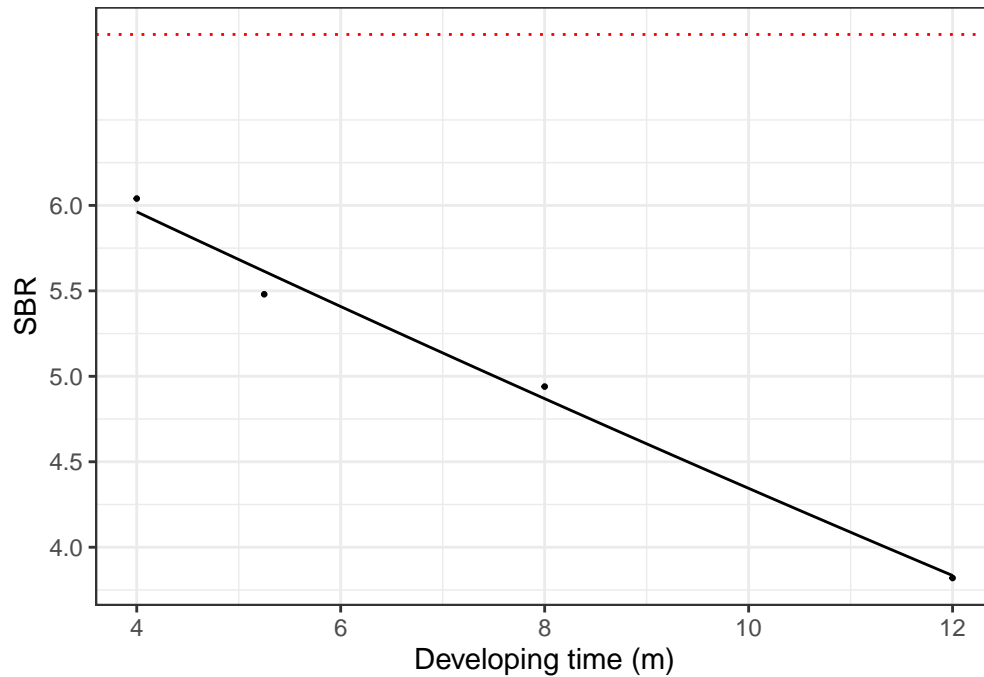


Catlabs Pro 320 35mm / D76 1+1 / 20C

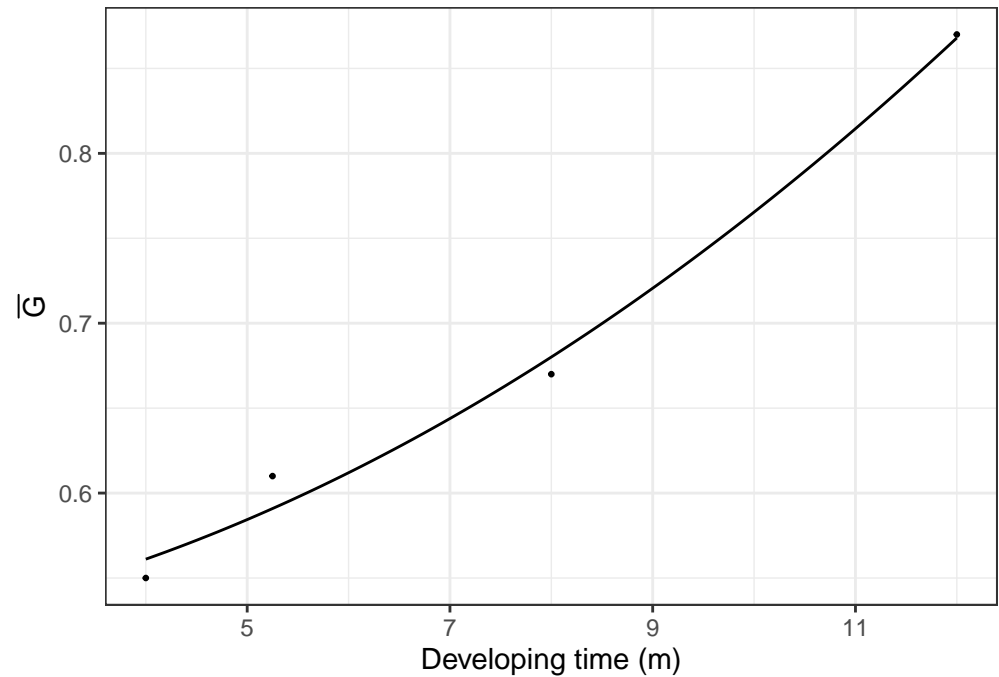


Catlabs Pro 320 35mm / D76 1+1 / 20C

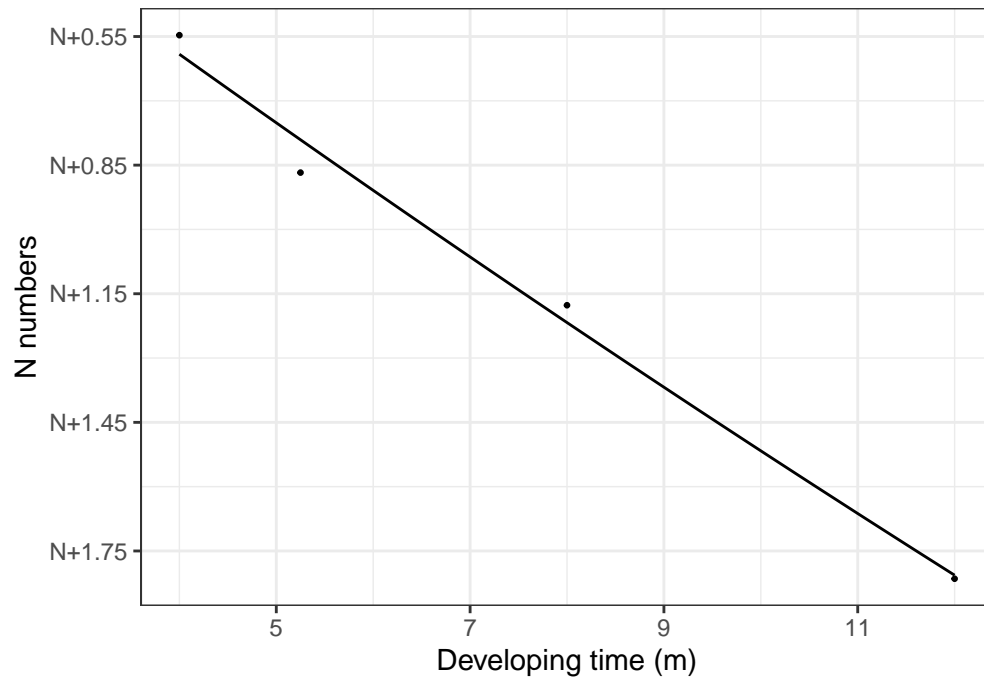


Catlabs Pro 320 35mm / D76 1+1 / 20C

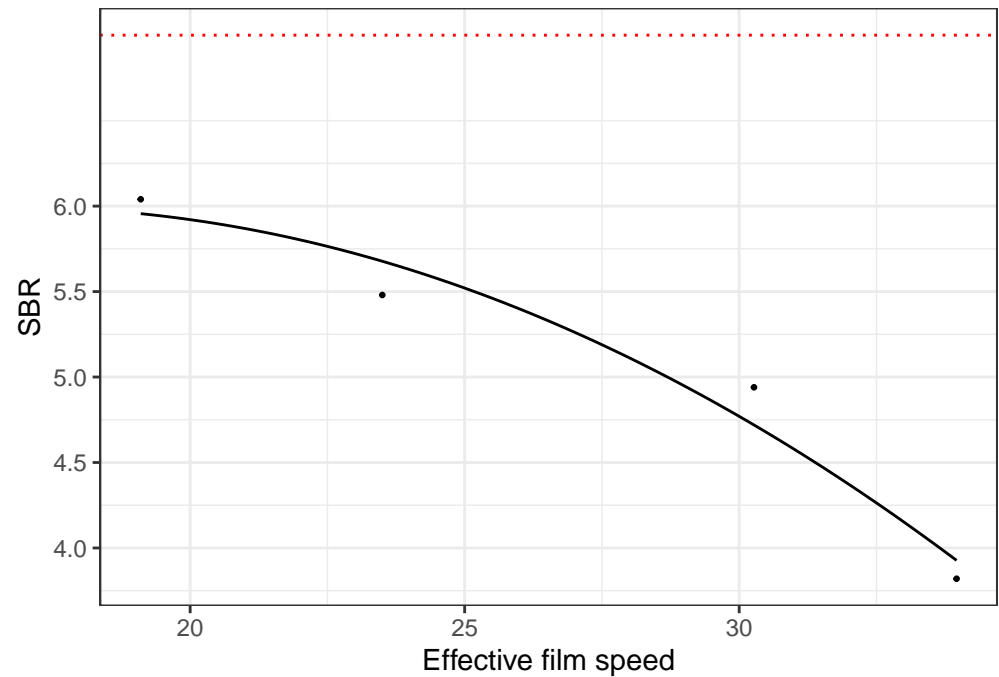


Catlabs Pro 320 35mm / D76 1+1 / 20C

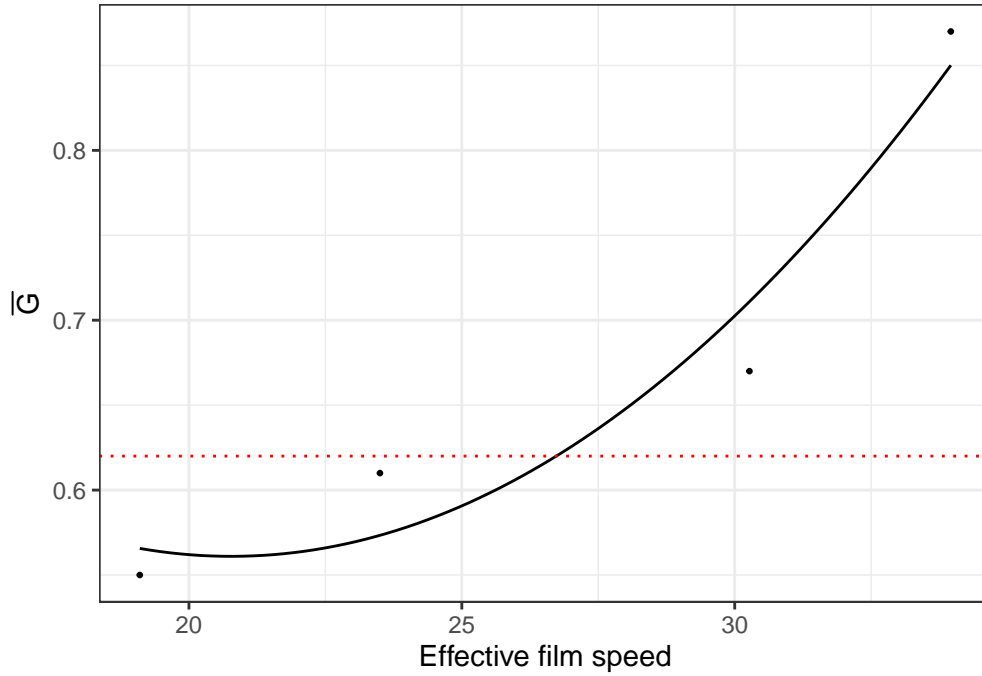

Catlabs Pro 320 35mm / D76 1+1 / 20C

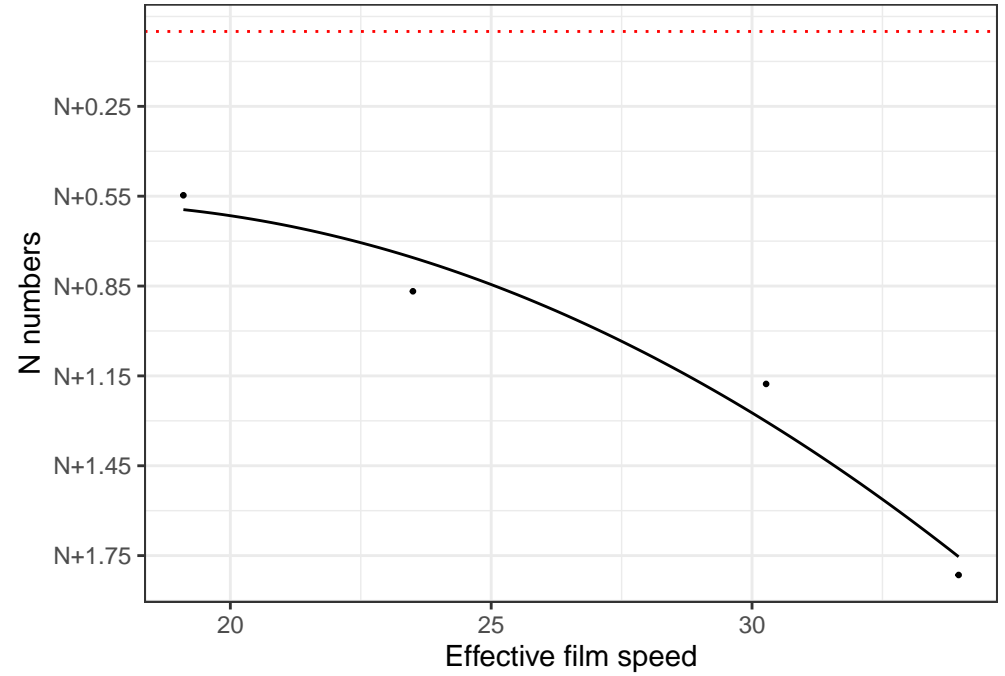

Catlabs Pro 320 35mm / D76 1+1 / 20C

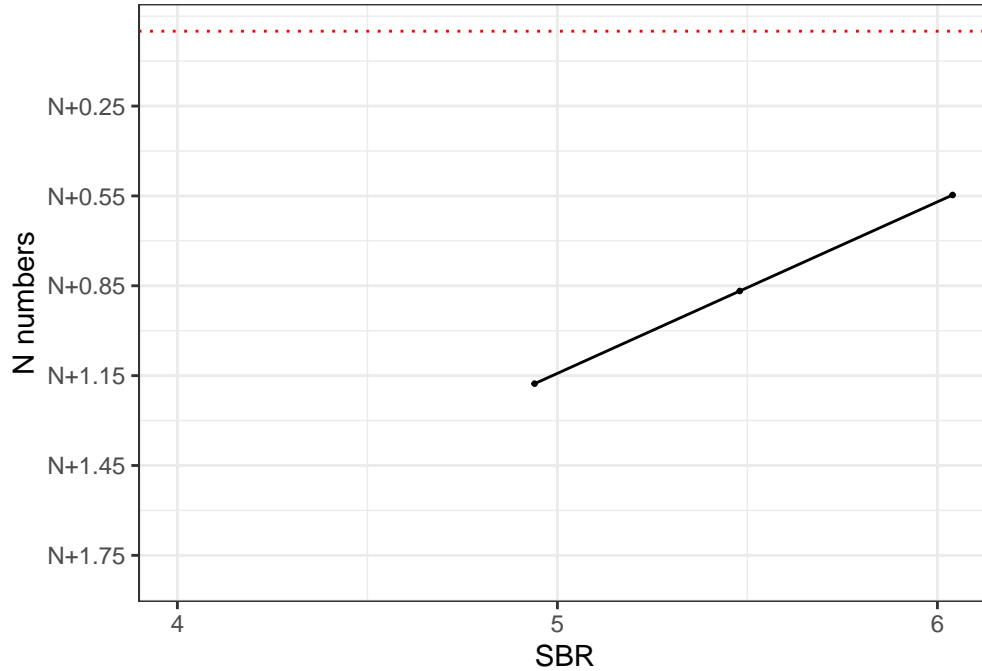

Catlabs Pro 320 35mm / D76 1+1 / 20C

